



记号	来历	年月日	订正	审查	记号	来历	年月日	订正	审查
①					④				
②					⑤				
③					⑥				

THE COLUMN WHICH LESS THAN DIAMETER 8.15mm CAN PASS THE PIPE, BUT THE COLUMN WHICH MORE THAN DIAMETER 7.5mm CAN'T PASS THE PROTRUSIVE POSITION.




DISCHARGE PIPE (NTS)

THE COLUMN WHICH LESS THAN DIAMETER 9.45mm CAN PASS THE PIPE.




SUCTION PIPE (NTS)

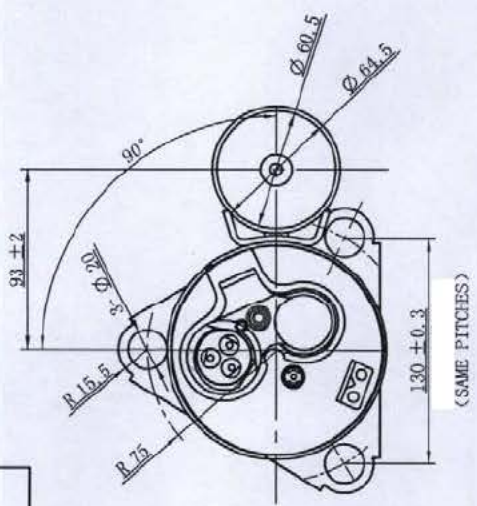

(SAME FITCHES)

GASKET

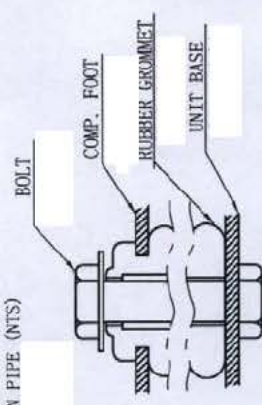

RUBBER GROMMET STRUCTURE

THE ACCUMULATOR APPEARANCE IS SUBJECT TO MATERIAL OBJECT

THE CONCRETE APPEARANCE IS SUBJECT TO MATERIAL OBJECT


NOTE:

1. THE TORQUE ENFORCED ON THE NUT IS 0.4~0.6N.m.

DIMENSION: mm

SCREW HOLE FOR EARTH (BOTH SIDES)

(TO USE M4 SCREW)

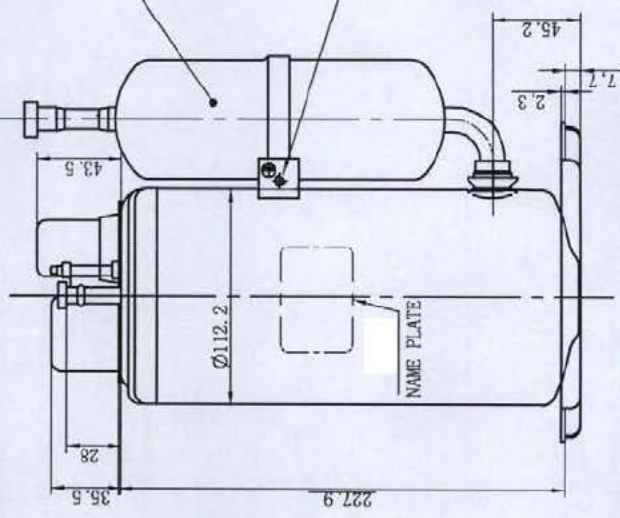

REGD	REL. MARKS	PROJECTION	SCALE	DIM. NO.
DNV. 请研辨	NTS	shanghai	NTS	
CHKD. 朱廷旭	TITLE	Huachi Ltd		
APPD. 朱廷旭	DIMENSIONED			
	SKETCH			